


KILLEAN WIND FARM

FIGURE 2.3

TYPICAL CRANE HARDSTAND

REF	DESCRIPTION	AREA (m ²)	MAINTENANCE
P1	MAIN HARDSTANDING	1925.0	PERMANENT
T1	BLADE LAYDOWN SUPPORTS	90.0	TEMPORARY
T2	ASSIST CRANE AREA	600.0	TEMPORARY
T3	BOOM SUPPORT	36.0	TEMPORARY
T4	ROTOR ASSEMBLY AREA	100.0	TEMPORARY
T5	TEMPORARY ACCESS	104.0	TEMPORARY

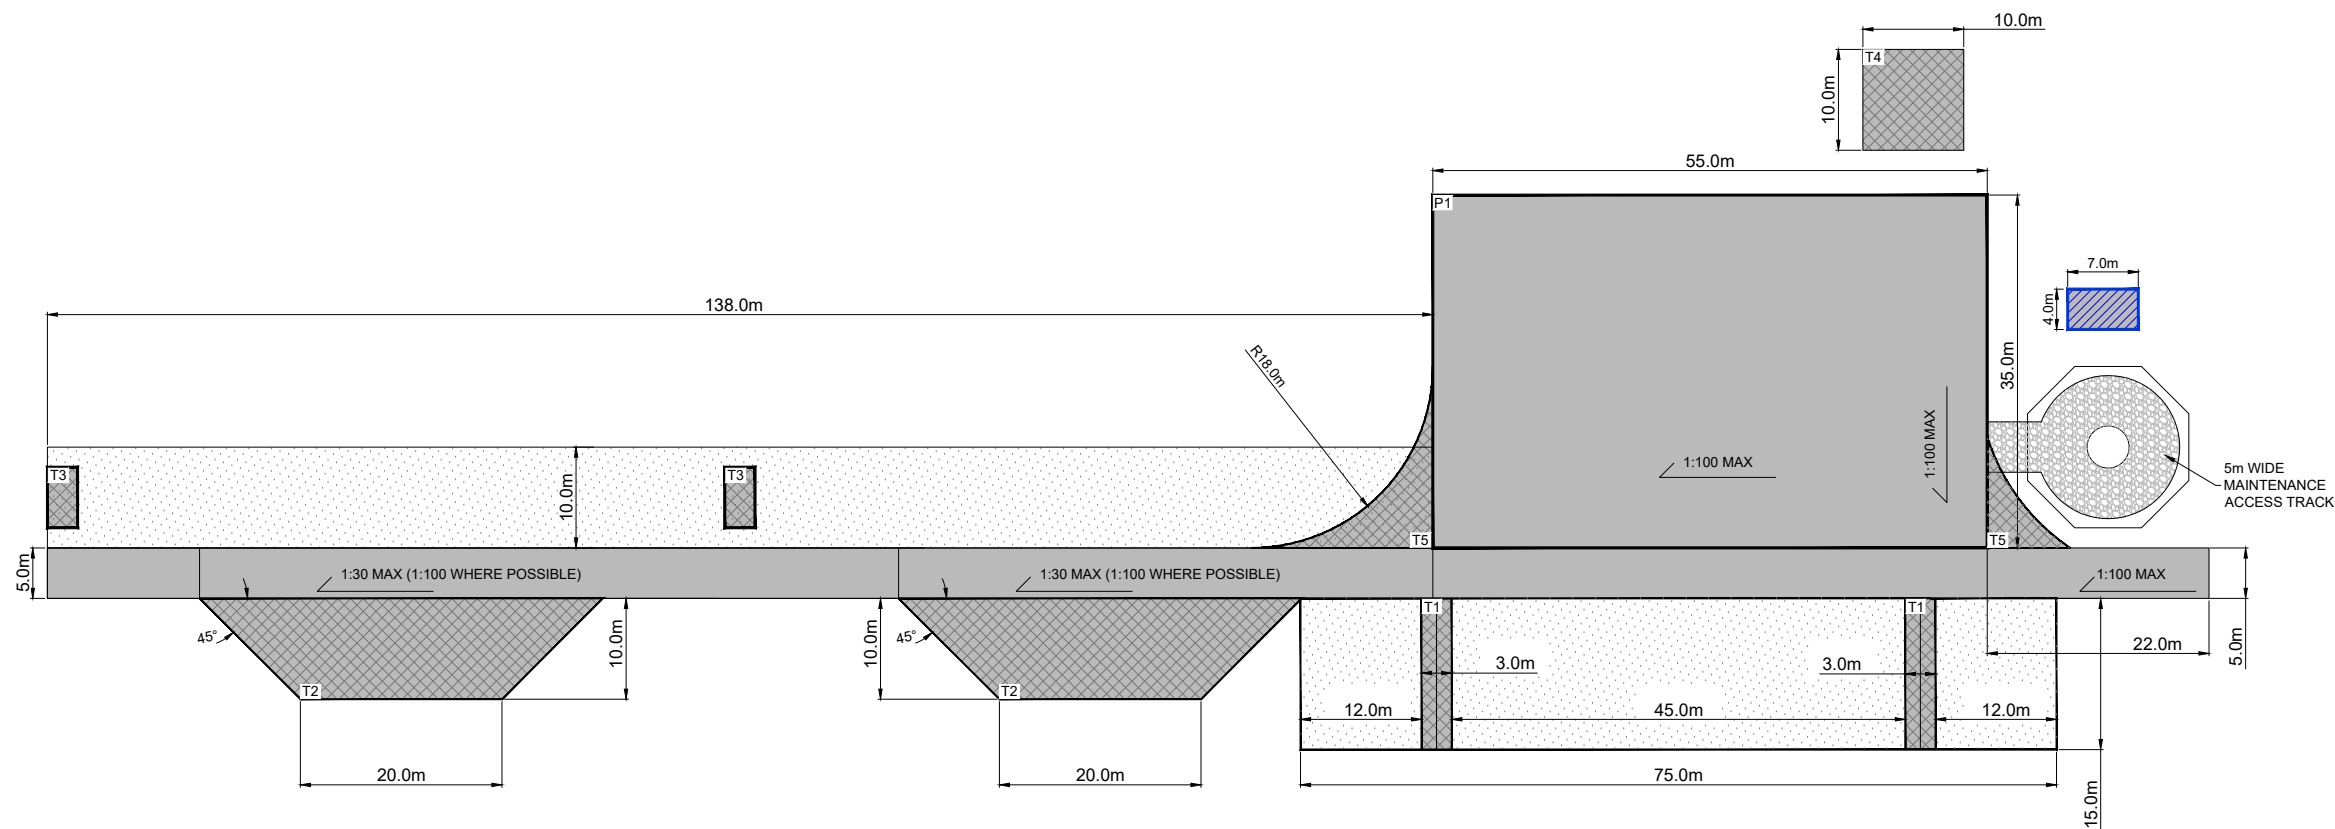

KEY

- PERMANENT WORKS
- TEMPORARY WORKS
- EXTERNAL TRANSFORMER AND SWITCHGEAR ENCLOSURE
- AREA TO BE FREE FROM TOPOGRAPHICAL AND ECOLOGICAL CONSTRAINTS
- MAINTENANCE ACCESS TRACK

NOTES

1. ALL DIMENSIONS IN METRES.
2. HARDSTAND ARRANGEMENT SUBJECT TO CHANGE DEPENDANT ON SPECIFIC WIND TURBINE MODEL SELECTED FOR CONSTRUCTION.
3. ALL HARDSTANDS TO BE CONSTRUCTED ON SUITABLE FOUNDATION MATERIAL.
4. ALL HARDSTANDS TO BE FINISHED WITH CRUSHED ROCK, FORMING A FREE DRAINING SURFACE.
5. TRACK ADJACENT TO CRANE HARDSTAND TO BE DESIGNED TO ACCEPT CRANE OUTRIGGER LOADING.
6. THE PRELIMINARY CRANE HARDSTAND LAYOUT HAS BEEN DEVELOPED TO ACCOMMODATE EITHER A SINGLE BLADE LIFT OR FULL ROTOR LIFT.
7. TO PROTECT AGAINST INJURY, SUITABLE EDGE PROTECTION IS REQUIRED WHERE THERE IS A DIFFERENCE OF GREATER THAN 1M BETWEEN THE HARDSTAND SURFACE AND THE ADJACENT GROUND.

LAYOUT DWG	N/A	T-LAYOUT NO.	N/A
------------	-----	--------------	-----

DRAWING NUMBER	03226-RES-ERW-DR-PT-001	REV	1
----------------	-------------------------	-----	---

SCALE - 1:750 @ A3

ENVIRONMENTAL IMPACT ASSESSMENT REPORT 2024

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LTD. AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION